


3 pcs of  
**ITS-05-ER-230-L-1FL-1S**  
 Light column

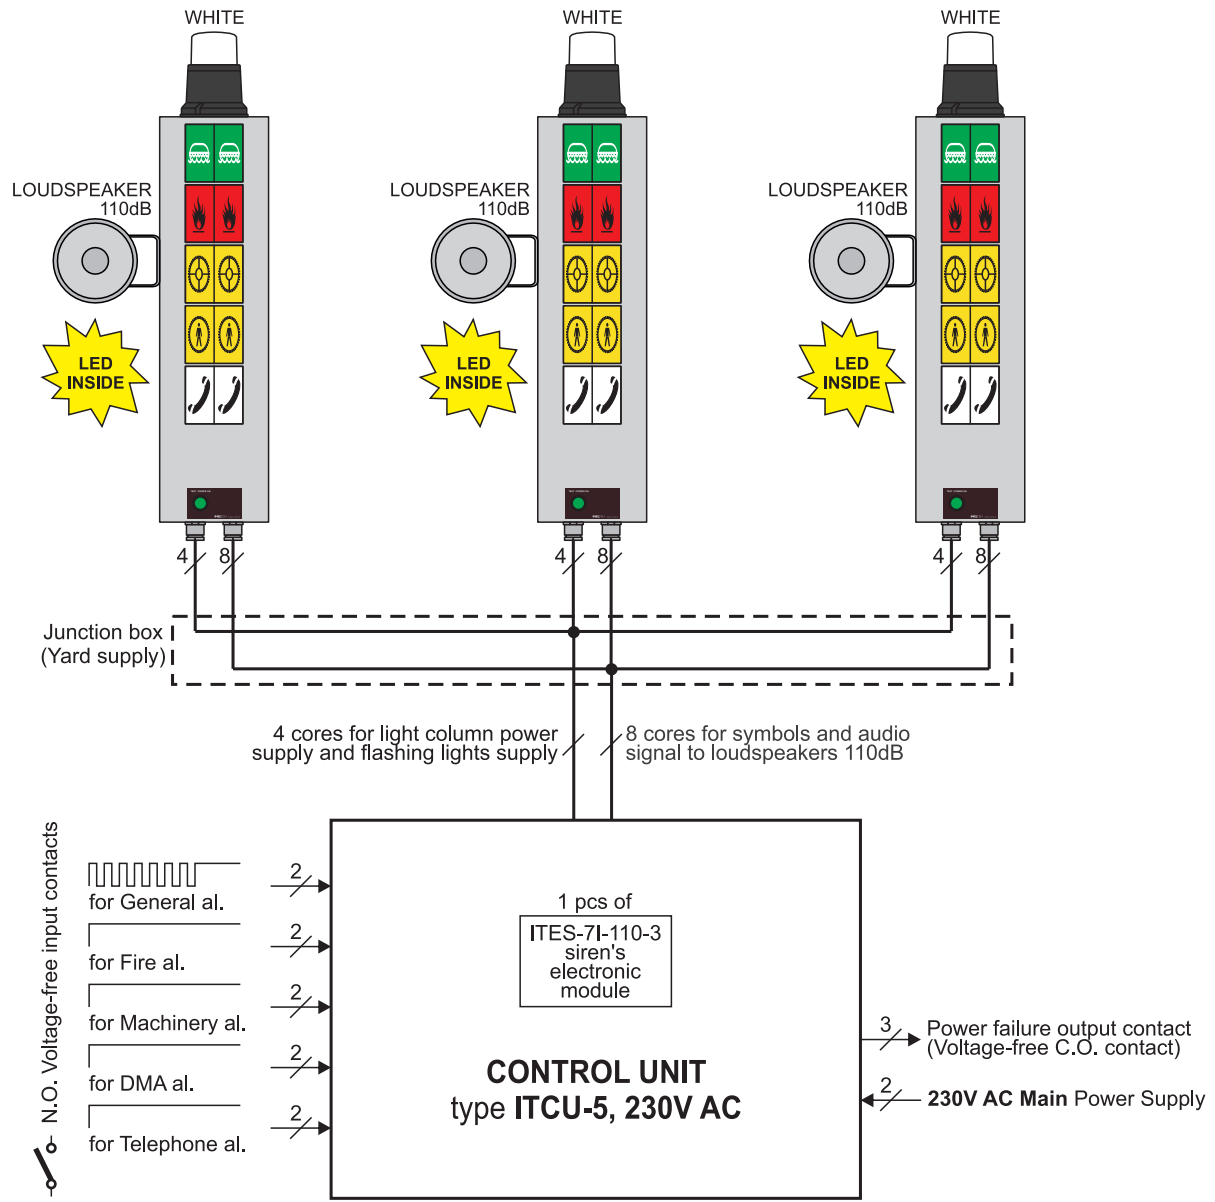

\*\*\*NOTE: Input contact for general alarm should follow general alarm sequence waveform (7 short and 1 long).

			Date	Name	Title:			
			Project.		<b>ENGINE ROOM SIGNALIZATION SYSTEM</b>			
			Constr.	15.12.17. Sirotnjak				
			Check					
Rev	Changes	Date/Sign	 ENGINEERING FOR ELECTRONIC EQUIPMENT AND SYSTEMS			Block diagram		
This drawing is the property of INELTEH d.o.o. and must not be reproduced, copied or distributed, entirely or in part, without written permission of INELTEH d.o.o.						Identity:	I-16503-3	File: